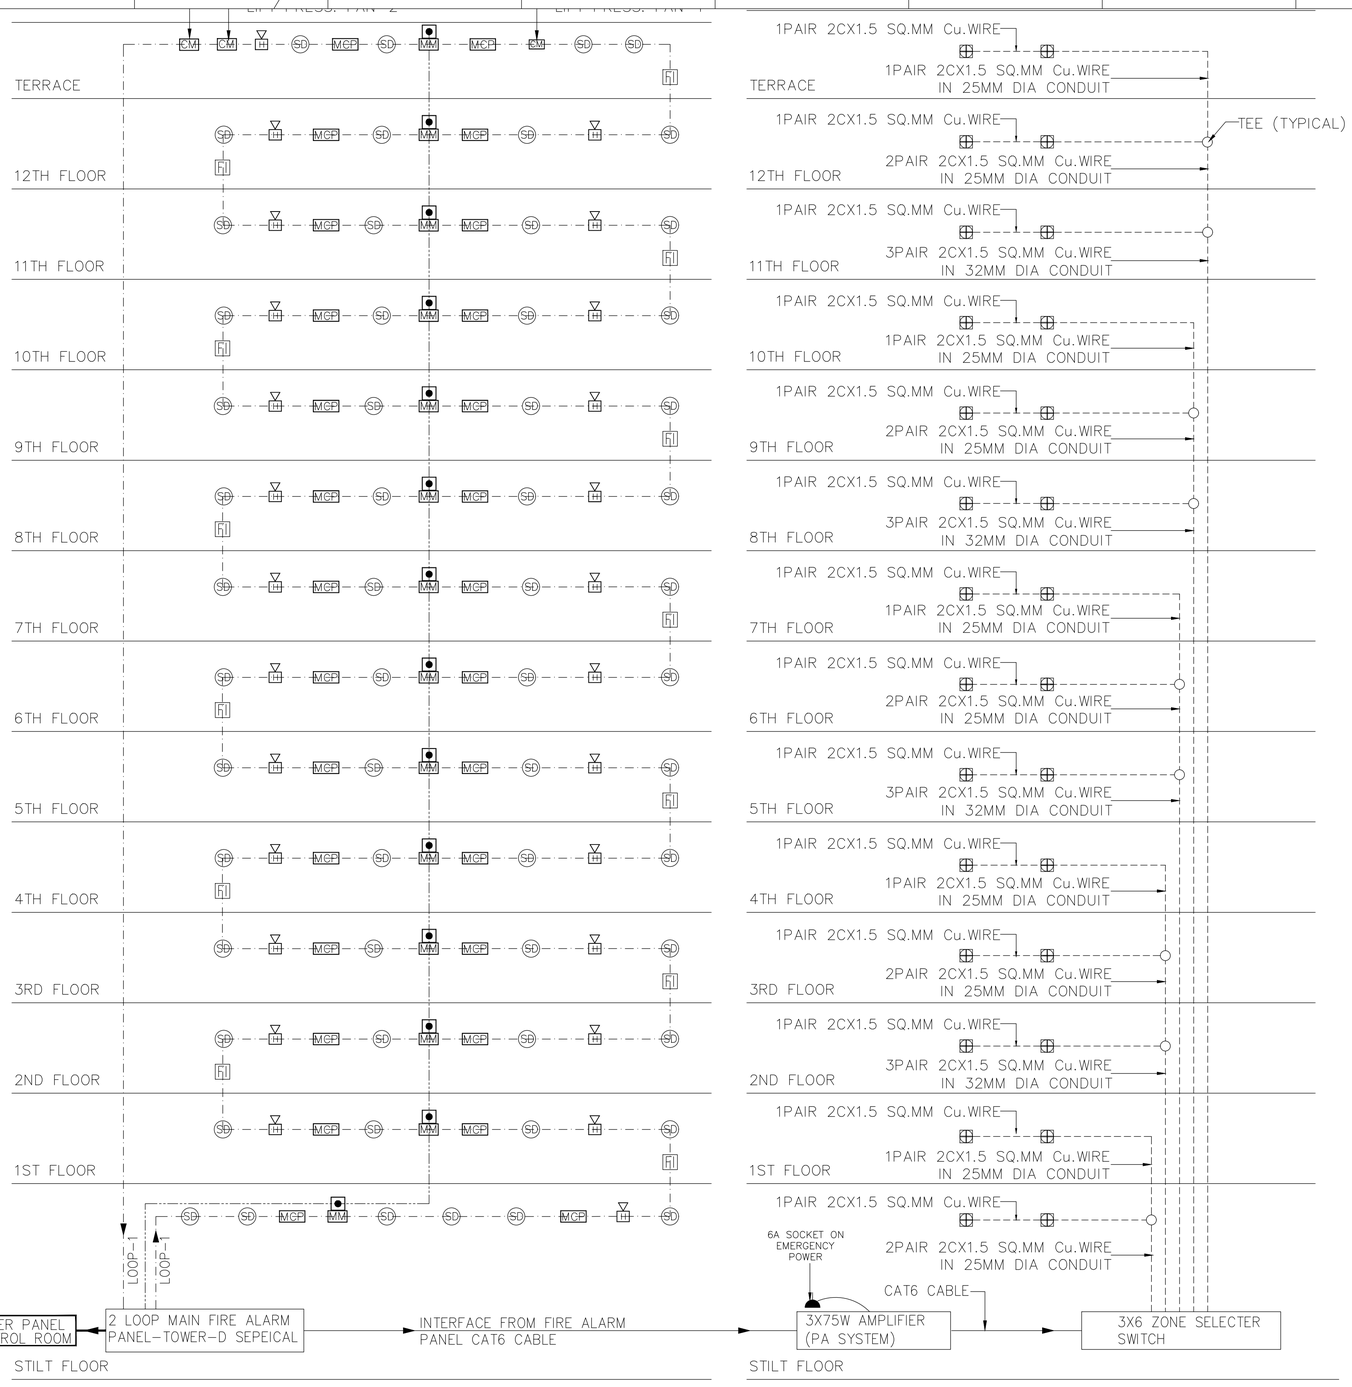

LEGENDS: –

S.NO	SYMBOL	DESCRIPTION
01.		FIRE MAN'S TELEPHONE JACK
02.		HOOTER WITH STROBE
03.		MANUAL CALL POINT
04.		MONITOR MODULE
05.		CONTROL MODULE
06.		SMOKE DETECTOR
07		FAULT ISOLATOR
08.		6W WALL MOUNTED SPEAKER
09.		2CX1.5 SQ.MM Cu. HFFR WIRE IN PVC CONDUIT
09.		2CX1.5 SQ.MM Cu. HFFR WIRE IN PVC CONDUIT FOR FIRE PHONE JACK

GENERAL NOTES:

* ALL DIMENSIONS ARE IN MILLIMETERS, LEVELS IN METER. ALL DIMENSIONS ARE TO BE READ AND NOT MEASURED.

* ANY/ ALL DISCREPANCIES MUST BE BROUGHT TO THE NOTICE OF THE CONSULTANT BEFORE PROCUREMENT/ EXECUTION OF WORK AT SITE.

* THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL, STRUCTURAL, PLUMBING, FIRE FIGHTING, ELECTRICAL LAYOUTS AND RELATED SHOP–DRAWINGS.

* ALL WALLS ARE ALIGNED TO FACE OF CONCRETE COLUMNS OR ARE ON CENTERLINE OF GRIDS UNLESS NOTED OTHERWISE.

* ALL CIVIL WORKS AROUND/IN MEP AREAS SHALL BE CONSTRUCTED AS PER MEP CONSULTANT DETAILS & REQUIREMENT, AND SHALL BE CONSTRUCTED POST MEP SERVICES INSTALLATION/COMMISSIONING.

* ALL FINISHES/LAYOUT OF LIFT–CORE, LOBBY, LOBBY TOILET, ETC. SHALL BE AS PER DESIGN DETAIL.

* ALL SPARE SHAFT/UNTILIZED OUTOUTS OF SHAFTS SHALL BE FIRE–SEALED.

* LIFT DOORS JAMB/WALLS/LINTELS SHALL BE EXECUTED ONLY UPON FINALIZATION OF LIFT SHOP DRAWINGS.

* FFL, FGL, ETC. LEVELS MENTIONED ARE TO BE READ WITH REFERENCE FROM CONTIGUOUS DRIVEWAY. BLOCK DRIVEWAY LEVELS ARE TO BE REFERRED FROM SITE SETTING–OUT PLAN.

REV.	DATE	REVISION NOTE
R1	06.03.2026	ISSUED FOR COMMENTS/APPROVAL
R0	25.02.2026	ISSUED FOR COMMENTS/APPROVAL

No.	LOCATION	DESCRIPTION	DR'N.	DES'D.	D.CHK'D.	REV'D.	APP'D.
R1		ISSUED FOR COMMENTS/APPROVAL	SS	SS	AD	AD	AD
R0		ISSUED FOR COMMENTS/APPROVAL	SS	SS	AD	AD	AD

REVISIONS — SIGNATURE WITH DATE

REFERENCE DRAWINGS	DRAWING No.

DRG. No. NPCL–KAGA–WD–ELV–DSP–130

A2

NUCLEAR POWER CORPORATION OF INDIA LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)

REVIEWED:	APPROVED:
NAME:	NAME:
DATE:	DATE:

DRAWING NO. (NPCIL INTERNAL DWG. NO.): KAIGA–1–6/91214/5002/ELE/R0

REVISION NO.: R0

ARCHITECT:

VYOM
ARCHITECTS & ENGINEERS
E-147, OKHLA PHASE-3, NEW DELHI 110020.
T: +91 11 2691 0018 / 0019
E: INFO@VYOM.IN W: WWW.VYOM.IN

TITLE :– SCHEMATIC DIAGRAM FOR FIRE ALARM & PA SYSTEM TYPE–D SPECIAL

DES'D. DATE		DR'N. DATE	SS 06/03/2026
DES. CHK'D. DATE		DRG. CHK'D. DATE	AD 06/03/2026
REV'D. DATE	AD 06/03/2026	APP'D. DATE	AD 06/03/2026

PROJECT KAIGA–5&6 TOWNSHIP

SCALE N.T.S.

PROJECTION

DRG. No. NPCL–KAGA–WD–ELV–DSP–130

REV. No. R1

FLOPPY/CD No. FILE NAME: TYPE–D SPECIAL

DRG. TO BE READ IN CONJUNCTION WITH DCN/FCN/ECN, IF ANY.

THIS DESIGN AND DRAWING IS THE PROPERTY OF THE NUCLEAR POWER CORPORATION. IT MUST BE RETURNED WITH QUOTATION / TENDER OR UPON DELIVERY OF MATERIAL / ON DEMAND AND NOT BE USED / COPIED / LENT OR DISCLOSED EXCEPT BY PERMISSION OF THE OWNER.